


ANNUNCIATOR PROFILE 201



User	William Beaumont Hospital
Location	Royal Oak, Michigan
Integrator	Electronic Security Systems
Annunciator Models	Recessed 561AL-16 Local Recessed 561AR-16 Remote

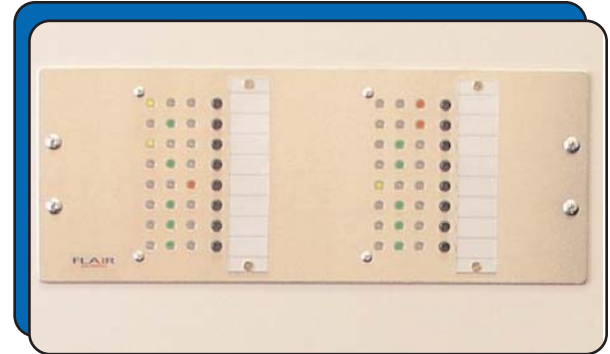

Model 561A-16

The William Beaumont Hospital is one of the largest and busiest in the region. Nurses and guards in the various wards prefer to use Flair Annunciators for monitoring critical doors. The hospital has a high end HID access control system with data on entry and exit events being sent to multiple locations. The Flair Annunciators are triggered by the HID door controls and provide the nurses and guards immediate visual and audible display of which doors are being used. Electronic Security Systems (ESS) has installed numerous Flair Annunciators at this hospital and just recently installed two Model 561A Recessed Annunciators in the psych ward connected by Flair's new Communication Module. This module allows up to 8 Annunciators to be connected via a single RS485 Cable with each Annunciator displaying the same information on door status and each Annunciator having complete control - Acknowledge, Reset and Bypass - of the zones. ESS states "We received really good support and training from Flair's technicians up front. We set up the Annunciators and connected them with the Communication Module and it worked the first time. We are skeptical about new equipment but the Flair Communication Module really works well."

After the installation, ESS had the following requests and plans for future Annunciators - (1) Can we get a custom zone identification plate? And (2) Can we use the Flair Annunciators to control other system equipment like magnetic locks. The answer to both of these requests is YES. Flair can engrave heavy duty multi-colored plastic plates with custom zone descriptions quickly and at a reasonable price. Also, by programming the individual zones with Flair's free configuration software to output upon bypass (arm/disarm) a magnetic lock or other device can be turned on and off anywhere in the system by pushing the zone push button. The status of that device will be identified by the corresponding zone yellow LED on all Annunciators in the system.

William Beaumont Hospital



Maternity Ward

